

ENERGY AUDIT REPORT
of
Sahayog Sevabhavi Sanstha's,
MOTHER TERESA NURSING SCHOOL,
Sahayog Educational Campus, Vishnupuri, Nanded




Year: 2021-22

Prepared by:

ENGRESS SERVICES

Yashashree, 26, Nirmal Bag Society,
Near Muktangan English School, Parvati, Pune 411009
Phone: 09890444795, Email: engress123@gmail.com



MAHARASHTRA ENERGY DEVELOPMENT AGENCY



Maharashtra Energy Development Agency

(Government of Maharashtra Institution)

Aundh Road, Opposite Spicer College Road, Near Commissionerate of Animal Husbandary,
Aundh, Pune, Maharashtra 411067

Ph No: 020-35000450

Email: eee@mahaurja.com, Web: www.mahaurja.com



ECN/2022-23/CR-43/1709

10th May, 2022

CERTIFICATE OF REGISTRATION FOR CLASS 'A'

We hereby certify that, the firm having following particulars is registered with **MAHARASHTRA ENERGY DEVELOPMENT AGENCY (MEDA)** under given category as "Energy Planner & Energy Auditor" in Maharashtra for Energy Conservation Programme of MEDA.

Name and Address of the firm : M/s Engress Services
Yashshree, 26, Nirmal Bag Society,
Near Muktangan English School,
Parvati, Pune - 411 009.

Registration Category : *Empanelled Consultant for Energy Conservation Programme for Class 'A'*


Registration Number : *MEDA/ECN/2022-23/Class A/EA-32.*

- Energy Conservation Programme intends to identify areas where wasteful use of energy occurs and to evaluate the scope for Energy Conservation and take concrete steps to achieve the evaluated energy savings.
- MEDA reserves the right to visit at any time without giving prior information to verify quarterly activities performed by the firm and canceling the registration, if the information is found incorrect.
- This empanelment is valid till **09th May, 2024** from the date of registration, to carry out energy audits under the Energy Conservation Programme
- The Director General, MEDA reserves the right to cancel the registration at any time without assigning any reasons thereof.

General Manager (EC)

PRINCIPAL

SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606



ENGRESS SERVICES

Yashashree, 26, Nirmal Bag Society,
Near Mukhtangan English School, Parvati, Pune 411 009
Tel: 09890444795 Email: engress123@gmail.com

Ref: ES/SSSMTNS/21-22/01



Date: 2/2/2023

CERTIFICATE

This is to certify that we have conducted Energy Audit at Sahayog Sevabhavi Sanstha's Mother Teresa Nursing School, Nanded in the Year 2021-22.


The College has adopted Energy Efficient Practices:

- Usage of Energy Efficient LED Fittings
- Usage of Energy Efficient BEE STAR Rated equipment
- Maximum usage of Day Lighting
- Installation of 10 kWp Capacity Roof Top Solar PV Plant

We appreciate the support of Management, involvement of faculty members and students in the process of Energy Conservation & making the campus Green.

For Engress Services,

A Y Mehendale,
Certified Energy Auditor
EA-8192


PRINCIPAL


S Mother Teresa Nursing School,
Vishnupuri, Nanded-431606

INDEX

Sr. No	Particulars	Page No
I	Acknowledgement	5
II	Executive Summary	6
III	Abbreviations	7
1	Introduction	8
2	Study of Connected Load	9
3	Study of Present Energy Consumption	10
4	Study of CO ₂ Emission	12
5	Study of Usage of Alternate Energy	14
6	Study of Usage Of LED Lighting	15



Shankar
PRINCIPAL
SSS's Mother Teresa Nursing School,
Vishnupuri, Nanded-431606




ACKNOWLEDGEMENT

We at Engress Services, Pune, express our sincere gratitude to the management of Sahayog Sevabhavi Sanstha's Mother Teresa Nursing School, Nanded, for awarding us the assignment of Energy Audit of their Nanded campus for the Year: 2021-22.

We are thankful to all Staff members for helping us during the field study.



Stani
PRINCIPAL
SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606



EXECUTIVE SUMMARY

1. Sahayog Sevabhavi Sanstha's Mother Teresa Nursing School, Nanded, consumes Energy in the form of Electrical Energy; used for various gadgets, office & other facilities

2. Present Energy Consumption & CO₂ Emission:

No	Parameter/ Value	Energy Purchased, kWh	CO ₂ Emissions, MT
1	Total	16426	14.78
2	Maximum	2825	2.54
3	Minimum	236	0.21
4	Average	1369	1.23

3. Energy Conservation projects already installed:

- Usage of Energy Efficient LED fittings
- Usage of BEE STAR Rated Equipment
- Installation of 10 kWp Solar PV Plant

4. Usage of Alternate Energy:

- The College has installed a Roof Top Solar PV Plant of Capacity 10 kWp.
- The Energy purchased from MSEDCL is 16426 kWh.
- The Energy Generated by Roof Top Solar PV Plant in 21-22 is 12000 kWh.
- The Total Energy Requirement is 28426 kWh.
- The percentage of usage of Alternate Energy to Annual Energy Demand is 42 %.

5. Usage of LED Lighting:

- The Total Lighting load of College is 1.22 kW.
- The LED Lighting Load is 0.54 kW.
- The % of LED Lighting to Total Lighting Load is 44 %.

6. Assumptions:

1. 1 kWh of Electrical Energy releases 0.9 Kg of CO₂ into atmosphere
2. Average Energy generated by 1 kWp Solar PV Plant : 4 kWh/Day
3. Annual Solar Energy Generation Days: 300 Nos


7. References:

- For CO₂ Emissions: www.tatapower.com
- For Roof Top Solar Energy generation: www.solarrooftop.gov.in



Efani
PRINCIPAL

SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606



ABBREVIATIONS

BEE	Bureau of Energy Efficiency
SSS	Sahayog Sevabhavi Sanstha
MSEDCL	Maharashtra Electricity Distribution Company Limited
kWh	Kilo Watt Hour
kWp	Kilo Watt Peak
Kg	Kilo Gram
MT	Metric Ton
CO ₂	Carbon Di Oxide
LED	Light Emitting Diode



Shant
PRINCIPAL
SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606



CHAPTER-I INTRODUCTION

1.1 Objectives:

1. To study Connected Load
2. To study Present Energy Consumption
3. To compute the CO₂ emissions
4. To study usage of Alternate Energy
5. To study usage of LED Lighting



1.2 Table No 1: General Details of the College:

No	Head	Particulars
1	Name of the Institution	Sahayog Sevabhavi Sanstha's Mother Teresa Nursing School
2	Address	Vishnupuri, Nanded, 431 606
3	Year of Establishment	2011
4	Affiliation	Maharashtra University of Health Sciences, Nashik

Eland
PRINCIPAL
SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606

CHAPTER-II STUDY OF CONNECTED LOAD

The major contributors to the connected load of the College are as under.


Table No 2: Equipment wise Connected Load:

No	Equipment	Qty	Load, W/Unit	Load, kW
1	40 W FTL	17	40	0.68
2	20 W LED	27	20	0.54
3	Ceiling Fan	66	65	4.29
4	PC	20	150	3
5	Printer	4	175	0.7
6	Other Load	10	150	1.5
7	Total			11



We present the above Data in a PIE Chart as under.

Chart No1: Connected Load:

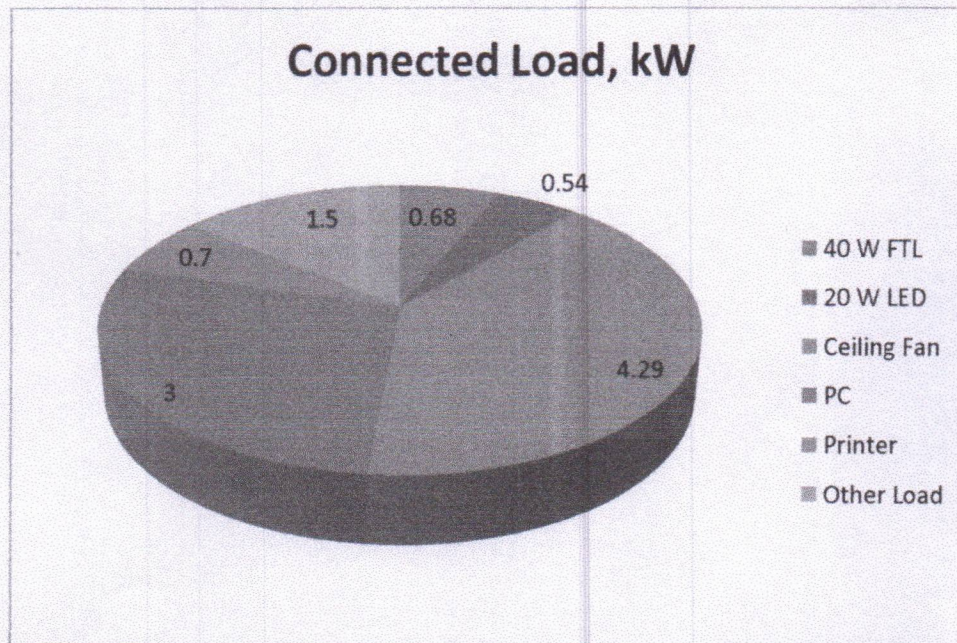

Stacy
PRINCIPAL

SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606


CHAPTER-III STUDY OF PRESENT ENERGY CONSUMPTION

In this chapter, we present the analysis of Energy Consumption
Table No. 3: Study of Electrical Energy Consumption: 21-22:



No	Month	Energy Purchased, kWh
1	Dec-21	515
2	Jan-22	236
3	Feb-22	249
4	Mar-22	1236
5	Apr-22	1911
6	May-22	797
7	Jun-22	1165
8	Jul-22	2650
9	Aug-22	2752
10	Sep-22	2825
11	Oct-22	1262
12	Nov-22	830
13	Total	16426
14	Maximum	2825
15	Minimum	236
16	Average	1369

Chart No 2: To study the variation of Monthly Electrical Energy Consumption:

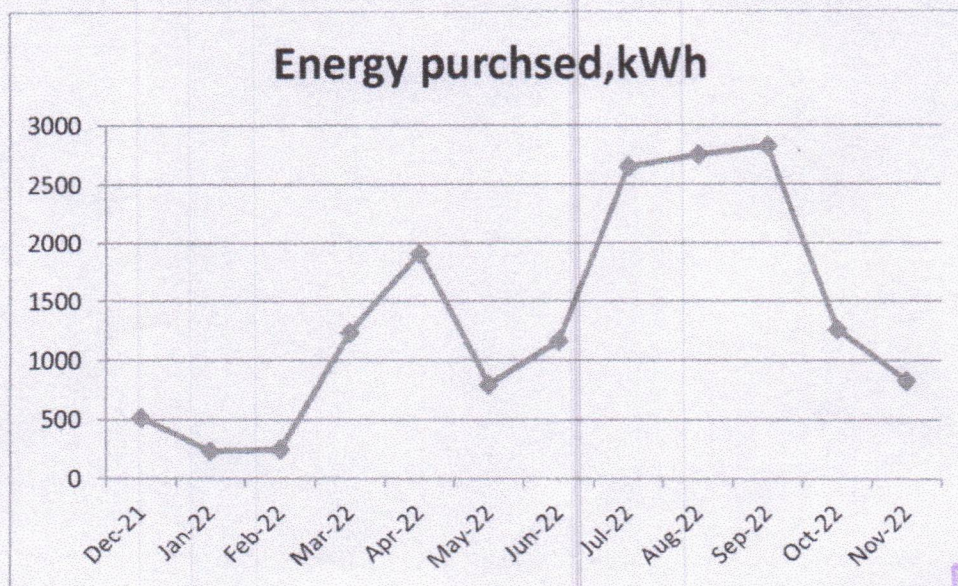

E. J. J.

PRINCIPAL

Mother Teresa Nursing School,
Vishnupuri, Nanded-431606




Table No 4: Important Parameters:

No	Parameter/ Variation	Energy Purchased, kWh
1	Total	16426
2	Maximum	2825
3	Minimum	236
4	Average	1369



Efani
PRINCIPAL
SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606





CHAPTER-IV STUDY OF CO₂ EMISSION

A Carbon Foot print is defined as the Total Greenhouse Gas emissions, emitted due to various activities.

In this we compute the emissions of Carbon-Di-Oxide, by usage of the various forms of Energy used by the College for performing its day to day activities

The College uses Electrical Energy for various Electrical gadgets.

Basis for computation of CO₂ Emissions:

The basis of Calculation for CO₂ emissions due to Electrical Energy is as under

- 1 kWh of Electrical Energy releases 0.9 Kg of CO₂ into atmosphere

Based on the above Data we compute the CO₂ emissions which are being released in to the atmosphere by the College due to its Day to Day operations

Table No 5: Month wise CO₂ Emissions:

No	Month	Energy Purchased, kWh	CO ₂ Emissions, MT
1	Dec-21	515	0.46
2	Jan-22	236	0.21
3	Feb-22	249	0.22
4	Mar-22	1236	1.11
5	Apr-22	1911	1.72
6	May-22	797	0.72
7	Jun-22	1165	1.05
8	Jul-22	2650	2.39
9	Aug-22	2752	2.48
10	Sep-22	2825	2.54
11	Oct-22	1262	1.14
12	Nov-22	830	0.75
13	Total	16426	14.78
14	Maximum	2825	2.54
15	Minimum	236	0.21
16	Average	1369	1.23

Etani

PRINCIPAL

SSS Mother Teresa Nursing School,
Vishnupuri, Nanded-431606




Chart No 3: Representation of Month wise CO₂ Emissions:


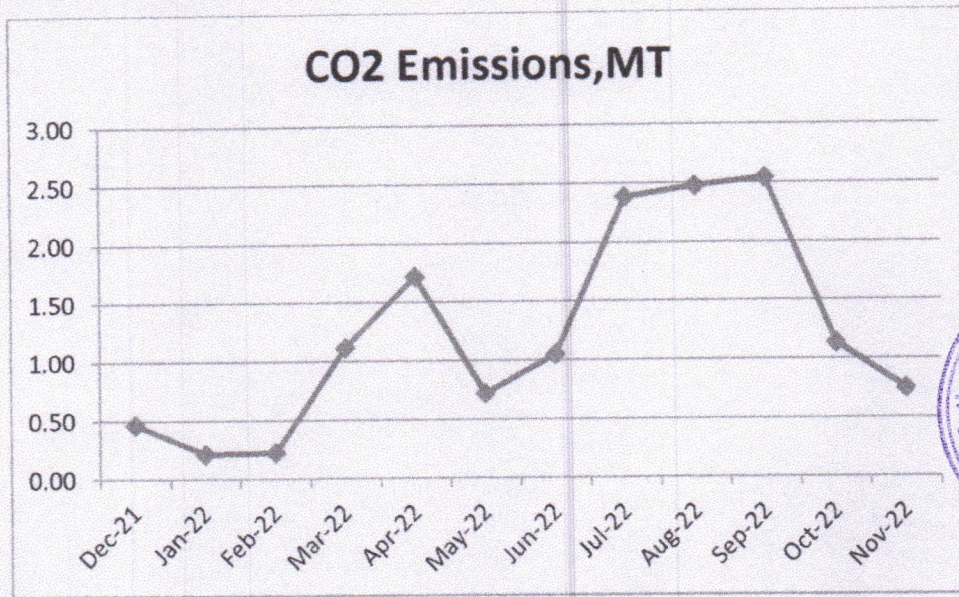



Table No 6: Important Parameters:


No	Parameter/ Value	Energy Purchased, kWh	CO ₂ Emissions, MT
1	Total	16426	14.78
2	Maximum	2825	2.54
3	Minimum	236	0.21
4	Average	1369	1.23

E. Sani

PRINCIPAL

SSS Mother Teresa Nursing School
Vishnupuri, Nanded-431606






CHAPTER-V STUDY OF USAGE OF ALTERNATE ENERGY

The College has installed a **10 kWp** capacity Roof top Solar PV Plant. Now we compute the Percentage of Alternate Energy to Annual Energy demand:

Table No 7: Percentage of Usage of Alternate Energy to Annual Energy Demand:

No	Particulars	Value	Unit
1	Energy purchased from MSEDCL	16426	kWh/Annum
2	Capacity of Roof Top Solar PV Capacity	10	kWp
3	Average Energy Generated per kWp per Day	4	kWh/kWp
4	Daily Energy Generated	40	kWh/Day
5	Annual Generation Days	300	Nos
6	Annual Energy Generated = 4*5	12000	kWh/Annum
7	Total Energy Requirement = (1) + (6)	28426	kWh/Annum
8	Percent of Alternate Energy to Annual Energy Requirement = (6)*100/(7)	42	%

Photograph of Roof Top Solar PV Plant:

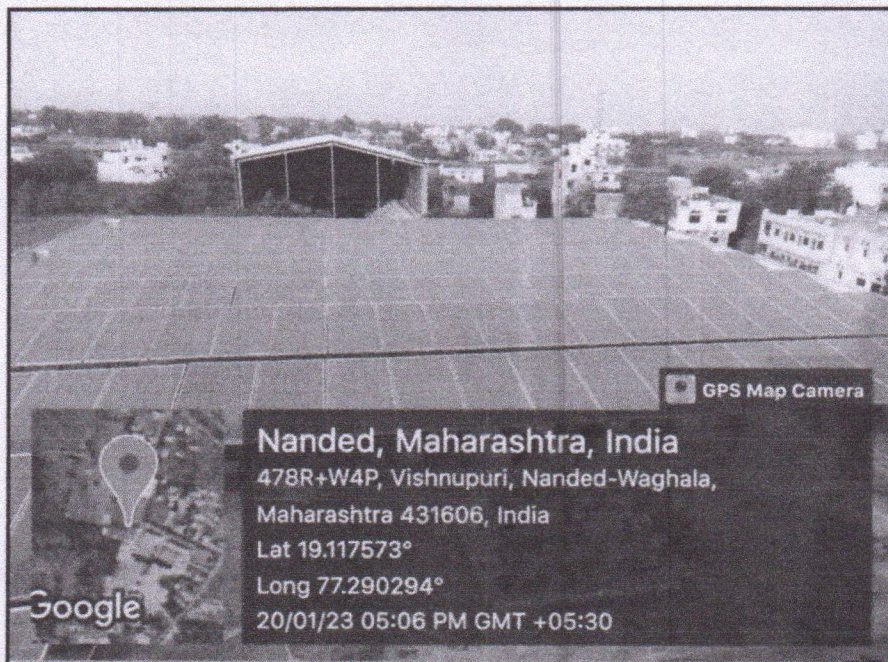

Elani

PRINCIPAL

SSS Mother Teresa Nursing School
Vishnupuri, Nanded-431606





CHAPTER VI STUDY OF USAGE OF LED LIGHTING

In this chapter, we compute the percentage of usage of LED Lighting to Total Lighting Load, as under.

Table No 8: Percentage of Usage of LED Lighting to Total Lighting Load:

No	Particulars	Value	Unit
1	No of 40 W FTL Fittings	17	Nos
2	Load/Unit of 40 W FTL Fittings	40	W/Unit
3	Total Load of 40 W FTL Fittings	0.68	kW
4	No of 20 W LED Fittings	27	Nos
5	Load/Unit of 20 W LED Fittings	20	W/Unit
6	Total Load of 20 W LED Fittings	0.54	kW
7	Total LED Lighting Load= 6	0.54	kW
8	Total Lighting Load= 3+6	1.22	kW
9	% of Annual LED Lighting to Total Lighting Load= $7 \times 100 / 8$	44	%

Sunit
PRINCIPAL
SSS's Mother Teresa Nursing School,
Vishnupuri, Nanded-431606

